



Features

- Balanced TRIGARD®
- Approximately 8 mm diameter, 11 mm long
- UL Recognized 
- Custom configurations available
- High surge current rating
- Stable breakdown throughout life
- RoHS compliant* version available

Applications

- Telecommunications
- Industrial electronics
- Commercial electronics
- Consumer electronics
- Automotive, aircraft, military electronics

2026 Series - 3-Pole Gas Discharge Tube

Characteristics

Test Methods per ITU-T K.12, IEEE C62.31 and IEC 61643-311 GDT standards.

| Characteristic | Model No. | | | | | | |
|-----------------------------------|-----------|---------|---------|---------|---------|---------|---------|
| | 2026-07 | 2026-09 | 2026-15 | 2026-20 | 2026-23 | 2026-25 | 2026-26 |
| DC Sparkover $\pm 20\%$ @ 100 V/s | 75 V | 90 V | 150 V | 200 V | 230 V | 250 V | 260 V |
| Impulse Sparkover ⁽¹⁾ | | | | | | | |
| 100 V/ μ s | 275 V | 275 V | 350 V | 425 V | 450 V | 475 V | 475 V |
| 1000 V/ μ s | 700 V | 600 V | 575 V | 625 V | 650 V | 700 V | 700 V |

| Characteristic | Model No. | | | | | |
|-----------------------------------|-----------|---------|---------|---------|---------|---------|
| | 2026-30 | 2026-35 | 2026-40 | 2026-42 | 2026-47 | 2026-60 |
| DC Sparkover $\pm 20\%$ @ 100 V/s | 300 V | 350 V | 400 V | 420 V | 470 V | 600 V |
| Impulse Sparkover ⁽¹⁾ | | | | | | |
| 100 V/ μ s | 550 V | 625 V | 675 V | 725 V | 800 V | 925 V |
| 1000 V/ μ s | 775 V | 875 V | 925 V | 1000 V | 1100 V | 1250 V |

⁽¹⁾ Impulse Sparkover voltage is defined as typical values of distribution.

| | | |
|--|---|---------------------|
| Impulse Transverse Delay..... | 1000 V/ μ s..... | < 75 ns |
| Insulation Resistance | 100 V (50 V for Model 2026-07 & 2026-09) | > $10^{10} \Omega$ |
| Glow Voltage | 10 mA..... | ~ 70 V |
| Arc Voltage | 1A..... | ~ 10 V |
| Glow-Arc Transition Current..... | | < 0.5 A |
| Capacitance | 1 MHz..... | < 2 pF |
| DC Holdover Voltage ⁽²⁾ | >135 V, (52 V for Model 2026-07 & 2026-09,..... | < 150 ms |
| | 80 V for Model 2026-15) | |
| Impulse Discharge Current..... | 40000 A, 8/20 μ s ⁽³⁾ | 1 operation minimum |
| | 20000 A, 8/20 μ s | > 10 operations |
| | 5000 A, 10/350 μ s | 1 operation |
| | 1000 A, 10/1000 μ s | > 400 operations |
| Alternating Discharge Current | 130 Arms, 11 cycles ⁽³⁾ | 1 operation minimum |
| | 20 Arms, 1 s | > 10 operations |
| Operation and Storage Temperature..... | | -40 to +90 °C |
| Climatic Category (IEC 60068-1)..... | | 40/ 90/ 21 |
| Moisture Sensitivity Level..... | | 1 |
| ESD Classification (HBM)..... | | 6 |

An optional Switch-Grade Fail-Short device is available. The optional Fail-Short assembly will activate at a temperature of 215 °C – 217 °C to provide a high conductive path to ground in case of a thermal overload. GDTs equipped with the optional Fail-Short device should be soldered either manually at a temperature that is below the activation temperature of the Fail-Short mechanism, or using a selective soldering process that does not exceed 210 °C.

Notes:

- Model number marking on tube: 26-xxx V.
- The rated discharge current for TRIGARD® Gas Discharge Tubes is the total current equally divided between each line to ground.
- Sparkover limits after life $\pm 25\%$, IR $> 10^8 \Omega$ (-25 %, +30 % for Model 2026-07, 2026-09 and 2026-60).
- Line to Line voltage is approximately 1.8 to 2 times the stated Line to Ground breakdown voltage.
- At delivery AQL 0.65 Level II, DIN ISO 2859

⁽²⁾ Network applied.

⁽³⁾ DC Sparkover may exceed $\pm 25\%$ after discharge, but will continue to protect without venting.

*RoHS Directive 2002/95/EC Jan. 27, 2003 including annex and RoHS Recast 2011/65/EU June 8, 2011.

Specifications are subject to change without notice.


The device characteristics and parameters in this data sheet can and do vary in different applications and actual device performance may vary over time. Users should verify actual device performance in their specific applications.

2026 Series - 3-Pole Gas Discharge Tube


BOURNS®

Product Dimensions (additional lead form configurations available upon request)


2026-XX-A

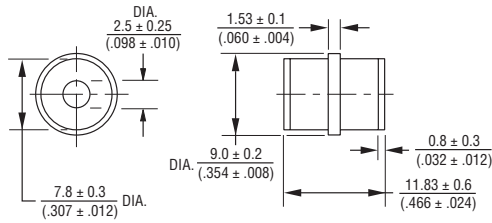


2026-XX-A1

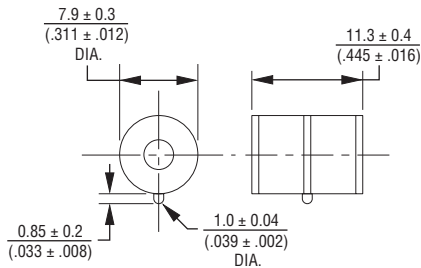


2026-XX-C2

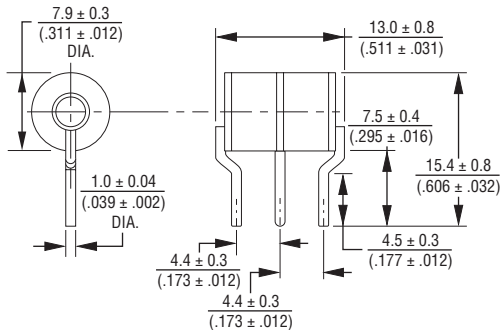

2026-XX-C3

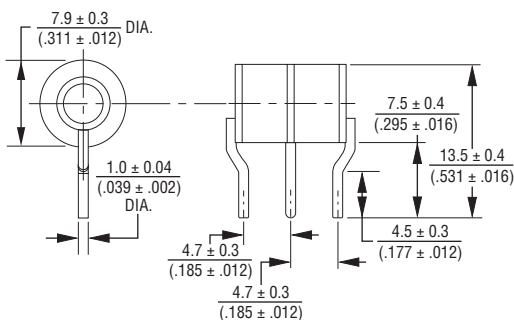


2026-XX-C4

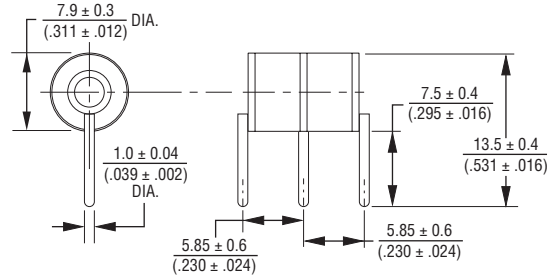


2026-XX-C

1.0 \pm 0.08 mm (.039 \pm .002 in.) dia. lead wire

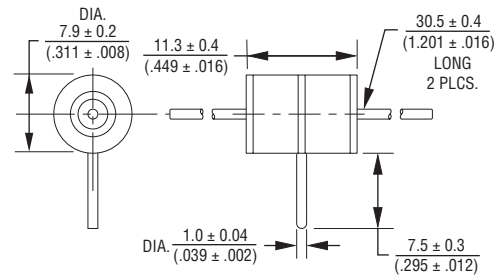

**FAIL-SHORT CONFIGURATION
2026-XX-C2F SHOWN**

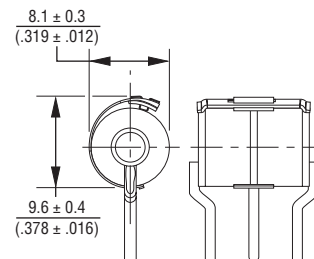

DIMENSIONS: $\frac{\text{MM}}{(\text{INCHES})}$

UNITS WITH LEADS ARE BASED ON THE 2026-XX-A1 BODY.

Specifications are subject to change without notice.
The device characteristics and parameters in this data sheet can and do vary in different applications and actual device performance may vary over time.
Users should verify actual device performance in their specific applications.

2026 Series - 3-Pole Gas Discharge Tube

BOURNS®

How to Order

Model Number Designator **2026 - nn - x n F LF**

Voltage (Divided by 10) _____

| | |
|------------|------------|
| 07 = 75 V | 30 = 300 V |
| 09 = 90 V | 35 = 350 V |
| 15 = 150 V | 40 = 400 V |
| 20 = 200 V | 42 = 420 V |
| 23 = 230 V | 47 = 470 V |
| 25 = 250 V | 60 = 600 V |
| 26 = 260 V | |

Leads _____

A = None
C = 1 mm

Lead Shape _____
(See Product Dimension Drawings)

Fail-Short Option _____

Blank = Standard Product
F = With Fail-Short Mechanism



RoHS Compliant Option _____

Blank = Standard Product
LF = RoHS Compliant Product

Packaging Specifications

| Model | Standard Packaging Quantity | | |
|------------|-----------------------------|------|------|
| | Bulk (Bag) | Tray | Box |
| 2026-XX-A | 250 | | 1000 |
| 2026-XX-A1 | 250 | | 1000 |
| 2026-XX-C | 50 | | 300 |
| 2026-XX-C2 | | 100 | 900 |
| 2026-XX-C3 | | 100 | 900 |
| 2026-XX-C4 | | 100 | 900 |


Agency Recognition / Industry Standards

| Agency | References |
|---|--|
|  | UL 497B Recognized Component, Category QVGQ2, File E153537 |
|  | UL 497 Recognized Component, Category QGVV2, File E53117 |
| Telcordia GR-974-CORE/ GR-1361-CORE | 2026 Series devices, as applicable, are tested to GR requirements for primary protectors |

2026 Series - 3-Pole Gas Discharge Tube

BOURNS®

Switch-Grade Fail-short Device Shorting Curve 2026-XX-XF

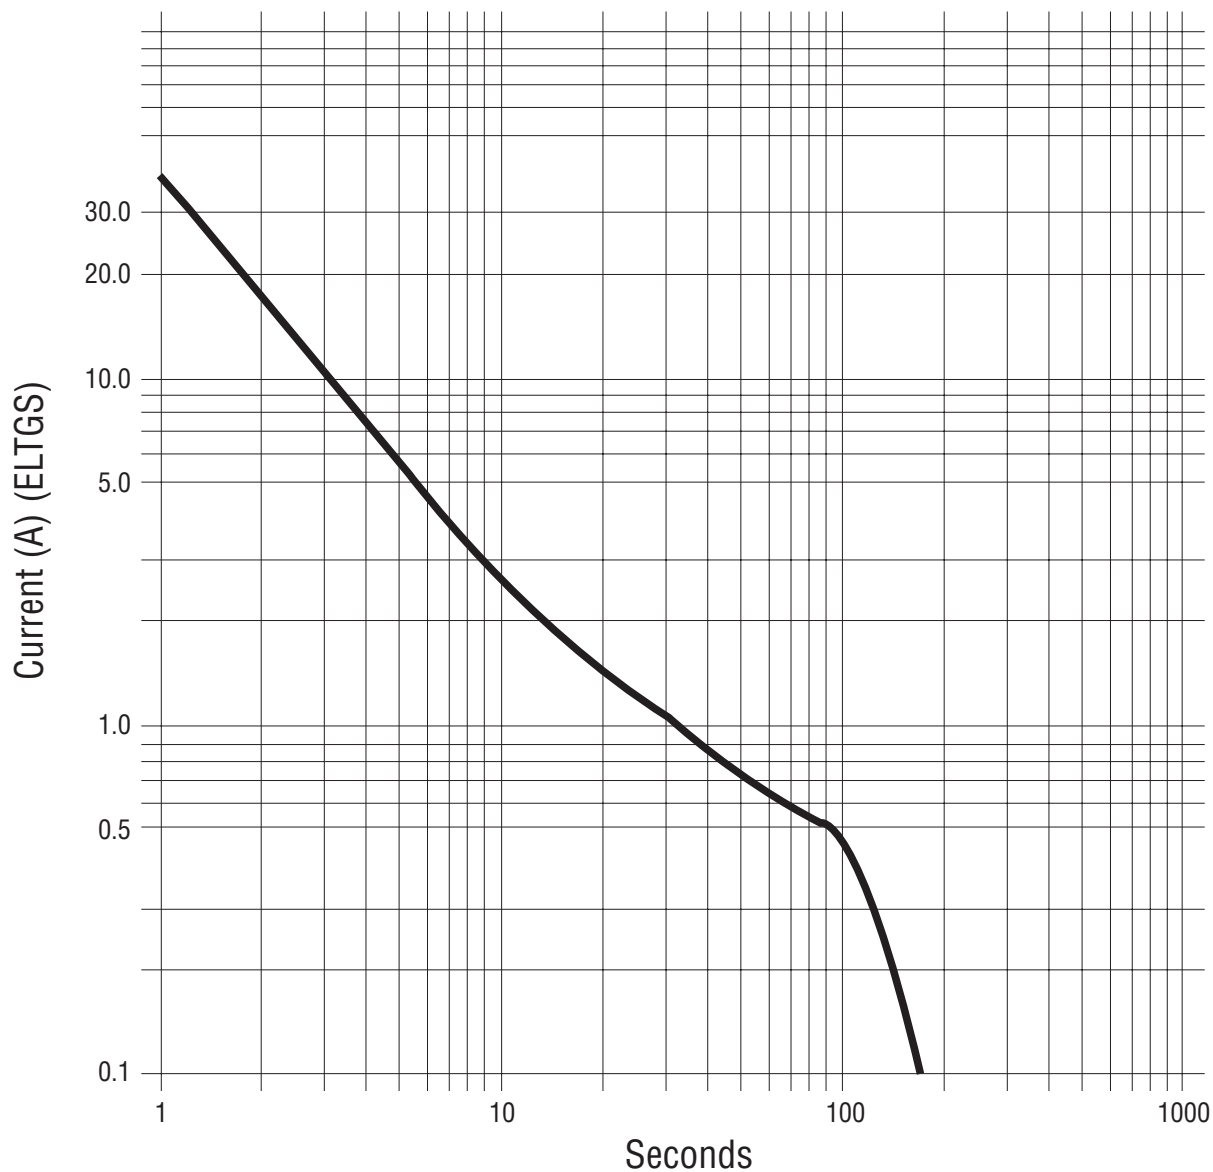

ELTGS = Each Line to Ground Simultaneously

NOTE: When using a GDT fail-short device, it is imperative that all components associated and connected to the GDT with failsafe be tested in their respective completely integrated environment (finished product) to assure desired operation.

REV. 08/17

Specifications are subject to change without notice.

The device characteristics and parameters in this data sheet can and do vary in different applications and actual device performance may vary over time. Users should verify actual device performance in their specific applications.